

# DATENBLATT

---

CPU-CA20(FIT)GY

## **HABEN SIE FRAGEN ODER WÜNSCHEN SIE EIN INDIVIDUELLES ANGEBOT?**

Unser Team berät Sie gerne persönlich.

**TELEFON** + 49 (0) 81 41/36 97-0

**TELEFAX** + 49 (0) 81 41/36 97-30

**E-MAIL** [info@plug-in.de](mailto:info@plug-in.de)

**WWW.PLUG-IN.DE**

## **ADRESSE**

Am Sonnenlicht 5

D-82239 Alling bei München



**F&eIT Series**  
**Ethernet Data Acquisition and Controlling Module**  
**CPU-CA20(FIT)GY**



\* Specifications, color and design of the products are subject to change without notice.

**Features**

The module does not require a fan as it uses a low power CPU with low heat dissipation. The compact design means it can be installed anywhere.

The module controls connected device modules such as digital I/O, and transfers monitoring and control data to and from a host PC or server unit via Ethernet.

The module can be used as part of a web-based system in conjunction with a F&eIT series I/O Assist Server Unit [SVR-IOAx(FIT)GY]\*1 and Monitoring and Control Server Unit [SVR-MMFx(FIT)GY]\*1.

The supplied driver library makes it easy to monitor and control external devices via a network from a host PC. Control applications can also be developed on UNIX and other non-Windows operating systems by using standard socket calls.

As in the case of other members of the F&eIT series, a mechanism for attachment to the 35mm DIN rail is provided in the system unit as a standard item. The system features a unique configuration that enables it to be connected to a module on the side in a stacking manner, which allows you to configure the system simply and elegantly without using backplanes and other connecting devices

\*1 The "x" in a model code represents a single digit (or no digit) indicating different products. (The same convention applies below).

**Packing List**

- Module < CPU-CA20(FIT)GY > ...1
- First Step Guide ...1
- Disk [F&eIT Series Setup Disk] \*1 ...1
- Power connector ...1
- Warranty Certificate...1
- Serial Number Label...1

\*1 The bundled disk contains various software and User's Manual (this manual)

This product is a controller module for transferring I/O data between a host PC and network. It can be used to process I/O signals from connected F&eIT series device modules. You can connect any combination of digital I/O, analog I/O, counter inputs, or other device modules (up to a maximum of eight modules).

The latest information on which device modules can be used is included in the Readme file on the bundled disk. If updating to the latest firmware, refer to the Readme file for the firmware.

Please read this manual carefully before performing system configuration such as developing application programs, setting switches, or connecting external devices..

**Specifications**

**Product specifications**

Item	Specs
CPU	SH4 240MHz
Memory	Flash ROM: 4Mbyte(32Mbit) SDRAM : 32Mbyte(256Mbit)
LAN controller	National Semiconductor DP83815 10/100BASE-TX controller Internal send (2KByte) and receive (2KByte) buffers Full duplex-capable
Interface (host side)	10/100BASE-TX(IEEE802.3u)
Interface (device side)	CONTEC original 8-bit bus
Number of connectable devices	8 units max. *1
Module connection method	Device units are directly connected to the right side of the system. Connection mechanisms are provided on the system unit as standard items.
Power supply voltage	Power is supplied by means of a 2-piece power input connector (detachable), 5VDC $\pm$ 5%, on the front side. Use of a F&eIT series power supply unit or an off-the-shelf stabilized power supply unit is recommended.
Power consumption-current	0.7A(Max) *2 (Exclusive of any power that is supplied to the device module)
FG pin	Power supply connector equipped with a FG pin.
External dimensions (mm)	25.2(W) $\times$ 64.7(D) $\times$ 94.0(H) (exclusive of any protrusions)
Weight	100g
Installation method	One-touch installation on a 35-mm DIN rail. The module includes a DIN rail mounting mechanism as a standard feature.

\*1 The sum of maximum current requirements of the units may not exceed the rated output current for the power supply unit.

\*2 The power for the device modules is supplied by means of a stack connector. The maximum allowable current on the stack connector is 3.0 A.

**Installation Environment Requirements**

Parameter	Requirement description
Operating temperature	0 - 50 °C
Storage temperature	-10 - 60°C
Humidity	10 - 80%RH (No condensation)
Floating dust particles	Not to be excessive
Corrosive gases	None
Line-Noise resistance	Line-noise *3 AC line/2kV, Signal line/1kV (IEC1000-4-2Level 3, EN61000-4-2Level 3)
	Static electricity resistance Contact discharge/4kV (IEC1000-4-2Level 2, EN61000-4-2Level 2)
Impact resistance	Atmospheric discharge/8kV (IEC1000-4-2Level 3, EN61000-4-2Level 3)
	Sweep resistance 10 - 57Hz/semi-amplitude 0.15mm, 57 - 150Hz/2.0G 80minutes each in X, Y, and Z directions (JIS C0040-compliant, IEC68-2-6-compliant)
Impact resistance	15G, half-sine shock for 11ms in X, Y, and Z directions (JIS C004-compliant, IEC68-2-27-compliant)
Grounding	Class D grounding (previous class 3 grounding)
Standard	VCCI Class A, FCC Class A, CE Marking (EMC Directive Class A, RoHS Directive)

\*3 When POW-AD22GY used



The role of the F&eIT Protocol

The F&eIT Protocol defines the following protocol layers.

Application layer	ACX, DLL, etc
Device-dependent control layer	
F&eIT protocol layer	F&eIT protocol specifications
Transport layer	UDP, ICMP
Network layer	IP, ARP
Data link layer	
Physical layer	Ethernet(IEEE802.3), etc

Basic Specifications

Concepts


The F&eIT Protocol assigns all device resources (including information) to virtual space so that any access to a device will be performed by specifying a virtual address. The virtual space is divided into information common to devices, device-specific information, I/O space, and memory space. The specific location in the virtual space where information is stored and the method by which information is stored is completely transparent to where or how information is stored in actual physical resources.

00000000h - 000FFFFh	Information common to devices (1M byte)
00100000h - 001FFFFh	Device-specific information (1M byte)
00200000h - 002FFFFh	Definition of device-specific information (1M byte)
00300000h - 003FFFFh	I/O space (1M byte)
00400000h - 004FFFFh	Memory space (1M byte)
FFE00000h - FFFFFFFh	Firmware update area (1M byte)


Data Communications Protocol

The F&eIT Protocol has two access procedures on the connectionless UPD/IP: response-type access and trap-type access.

(Response-type)

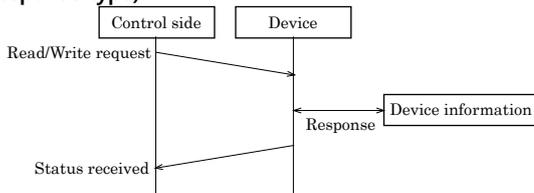

(Trap-type)

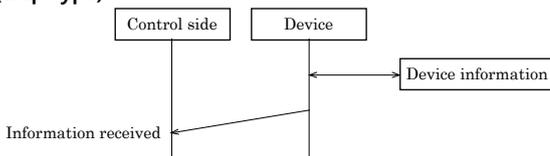


Setting a Group ID

By setting a Group ID, it is possible to manage the various operating modes (e.g., connecting an I/O assist server unit, starting the system on a stand-alone basis, or upgrading the system).

A Group ID can be set in a range of 0 - F.

Setup Method

A Group ID can be set by turning the rotary switch on the module face. To set a Group ID, turn the switch knob.



- 0 - 7 : I/O Assist Server Unit connection mode
- 8 : Stand-alone startup mode
- A : Stand-alone startup mode [CPU-CA20(FIT)GY only]
- 9, B - D : Not used
- E : System recovery and firmware upgrade mode
- F : Initialization mode \*1

CAUTION

A Group ID in the 0 - 7 range must be the same as the Group ID for the I/O Assist Server Unit.

When a CPU-CA20(FIT)GY is used with the Group ID set to "A" for standalone boot mode, use the utility software to set the Unit ID.

\*1 About Initialization mode


Restore the setting of this product to its factory settings. Set the Group ID to "F" and turn the power on. RUN and STATUS LEDs will start to flash. Once these LEDs stop flashing and grow solid, all settings (IP address etc) will be initialized and return to its factory settings after next boot.

Setting a Unit ID

By setting a Unit ID, it is possible to manage the units in the same group. A Unit ID can be set in a range of 0 - 7 (8 possible positions).

Setup Method

A Unit ID can be set by turning the rotary switch on the device face. To set a Unit ID, turn the switch knob.



CAUTION

The Unit IDs in the same group must all be unique within the group. When a CPU-CA20(FIT)GY is used with the Group ID set to "A" for standalone boot mode, use the utility software to set the Unit ID.

Connection Method

Supplying the Power

The module and the DC-DC power supply (POW-DDxx) can be cable-connected using the detachable connector that is provided on the unit face. (Compatible cables: AWG28 - 16)

Third-party DC output power supply unit can also be connected in the same way.


CAUTION

- The power for the device module is supplied from the stack connector.
- As the DC-DC power supply generates heat, provide a gap of at least 2.0cm between the power supply and module to ensure the air vents are not obstructed.

-The power supplied from the stack connector is 5.0VDC 3A. Although a maximum of eight units can be connected, be careful that the sum of the power requirements of the connected units is no greater than 3A.

-Input power requirements of the CPU-CA10(FIT)GY : 5.0VDC±5%, 0.5A (Max.)

Input power requirements of the CPU-CA20(FIT)GY : 5.0VDC±5%, 0.7A (Max.)

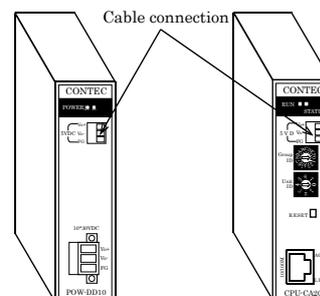

**Power Supply Unit**

Product type	Module type	Current consumption (5.0VDC)
DIO-8/8(FIT)GY	Isolated digital I/O module (12 - 24VDC)	0.15A
DI-16(FIT)GY	Isolated digital input module (12 - 24VDC)	0.15A
DO-16(FIT)GY	Isolated digital output module (12 - 48VDC)	0.15A
DIO-8/8H(FIT)GY	Isolated digital I/O module (36 - 48VDC)	0.15A
DI-16H(FIT)GY	Isolated digital input module (36 - 48VDC)	0.15A
DIO-4/4(FIT)GY	Isolated digital I/O module (Input:12 - 24VDC, Output:12 - 48VDC)	0.15A
DI-8(FIT)GY	Isolated digital input module (12 - 24VDC)	0.15A
DO-8(FIT)GY	Isolated digital output module (12 - 48VDC)	0.15A
DIO-8D(FIT)GY	Non-isolated buffered bi-directional digital I/O module	0.15A
DIO-16/16(FIT)GY	Isolated digital I/O module (12 - 24VDC)	0.15A
DI-32(FIT)GY	Isolated digital input module (12 - 24VDC)	0.15A
DO-32(FIT)GY	Isolated digital output module (12 - 48VDC)	0.15A
RRY-4(FIT)GY	Reed Relay junction Output Module	0.15A
ADI12-8(FIT)GY	Isolated analog input module	0.35A
ADI16-4(FIT)GY	Isolated high-precision analog input module	0.3A
DAI12-4(FIT)GY	Isolated analog output module	0.40A
DAI16-4(FIT)GY	Isolated high-precision analog output module	0.50A
PTI-4(FIT)GY	Input Module for Pt100 Thermo-sensor	0.50A
CNT24-2(FIT)GY	Isolated counter input module	0.15A
CNT16-8(FIT)GY	Isolated counter input module	0.15A
CNT16-8L(FIT)GY	Isolated counter input module	0.15A

\* Refer to the Readme file on the supplied CD for the latest information on the available device modules and their power consumption specifications.

**Connecting the SH-8008(FIT)H**

-These units are connected by means of an Ethernet interface.

-In situations where many lower-level groups are used, a hub should be provided between those groups and the CPU-CAxx(FIT)GY.

(CONTEC recommends the use of the switching HUB unit SH-8008(FIT)H in the F&eIT series of products.)

**Network cable**

Cables complying with the following specifications should be used:

Category 3,4 UTP cable (for 10BASE-T)

Category 5 UTP cable (for 100BASE-TX)

